

**STAB-LOK**  
LOAD CENTER

ALL MAIN CIRCUIT BREAKER HANDLES MUST BE IN "OFF" POSITION TO COMPLETELY DISCONNECT ELECTRICAL SERVICE

TO RESTORE SERVICE, MOVE HANDLE TO "ON" POSITION

TO REMOVE GAGE PAN UNTIL IT IS REINTEGRATED FROM BRACKET, SLIDE UP AND LIFT OUT

TO REPLACE REVERSE OPERATION

WHEN BREAKER TRIP HANDLE WILL MOVE TO "OFF" POSITION

FEDERAL PACIFIC ELECTRIC COMPANY  
NEWARK, N. J.

**CATALOG No. 1306-12-125**

125 AMPS. MAX.  
120/240 VOLTS A.C.  
1 PHASE 3 WIRE

1. 2 Pole Main Breaker  
2. 1 Pole Main Breaker  
3. 1 Pole Branch Breaker  
4. 1 Pole Branch Breaker  
5. 1 Pole Branch Breaker  
6. 1 Pole Branch Breaker  
7. 1 Pole Branch Breaker  
8. 1 Pole Branch Breaker  
9. 1 Pole Branch Breaker  
10. 1 Pole Branch Breaker  
11. 1 Pole Branch Breaker  
12. 1 Pole Branch Breaker  
13. 1 Pole Branch Breaker  
14. 1 Pole Branch Breaker  
15. 1 Pole Branch Breaker  
16. 1 Pole Branch Breaker  
17. 1 Pole Branch Breaker  
18. 1 Pole Branch Breaker  
19. 1 Pole Branch Breaker  
20. 1 Pole Branch Breaker

USE COPPER OR ALUMINUM WIRE

MAX. NO. BREAKER POLES  
WIRING PROGRAM LISTED  
1 PA OR 2 HC BREAKER POLES  
1 PA OR 1 HC BREAKER POLES  
1 HC BREAKER POLES

CIRCUIT BREAKERS ARE SUITABLE FOR USE WITH ALUMINUM OR COPPER WIRE WHEN SO MARKED.

**CIRCUIT DIRECTORY**

MAIN SECTION		BRANCH SECTION	
1		1	
2		10	MAIN
3		11	
4		12	MAIN
5		13	OUTSIDE
6		14	
7		15	RED ROOM
8		16	SUITES - 4F
9		17	KITCHEN DINING
		18	LIVING ROOM
		19	BED ROOM
		20	BATH - BALK LIFE

FEDERAL PACIFIC ELECTRIC COMPANY  
NEWARK, N. J.

WARNING: THE CIRCUIT BREAKERS IN THIS BOX HAVE BEEN SELECTED TO PROTECT THE WIRING IN THIS BOX OF PARTICULARS DO NOT REPLACE WITH A HIGHER TRIP CURRENT BREAKER, IF CHANGES ARE NECESSARY CALL A QUALIFIED ELECTRICIAN TO INSTALL THEM.

Manufactured by  
Federal Pacific Electric Co.  
NEWARK, N. J. 07102

MAIN  
DISCONNECT

FURN

AIR  
COND



1 2 3 4 OFF 5 6 7 8

WHEN BREAKER TRIPS  
HANDLE WILL MOVE  
TO "OFF" POSITION

TO REMOVE INTERIOR  
TURN ADJUSTING SCREW  
CLOCKWISE UNTIL MTG  
PLATE IS DISENGAGED  
FROM BARS. SLIDE  
INTERIOR SIDEWAYS  
AND LIFT OUT.

TO REPLACE INTERIOR  
REVERSE OPERATION  
FOR ADJUSTING BY PLW  
FOR READING OR  
LOWERING INTERIOR  
AS REQUIRED.

STAB-LOK  
LOAD CENTER

TO REMOVE SERVICE  
DOOR HANDLE TO  
"OFF" POSITION

9 10 11 12 OFF 13 14 15 16



MAIN  
LIGHTS

RANGE

### Cat. No. 108-16

100 AMPS 120/240 V, A.C.

1 PHASE 3 WIRE

16 MAX. BREAKER POLES

Suitable For Use as Service Equipment when not more than six Main Disconnecting means are provided, and used as permitted By Article 384 of The National Electrical Code.

For use with Federal Pacific Electric Co. Listed Circuit Breakers Type NA, NC or NAGF.

When Grounding Bar is Req'd use: GBK 7 (7 Terminals), GBK 11 (11 Terminals), or GBK 16 (16 Terminals) Bar Suitable for:

No. of Wires Per Terminal	Wire Size
1	14 - 4 CU
2 or 3	12 - 4 AL
	14, 12 or 10 CU
	12 or 10 AL

#### DIRECTORY

- 1. \_\_\_\_\_
- 2. \_\_\_\_\_
- 3. \_\_\_\_\_
- 4. \_\_\_\_\_
- 5. \_\_\_\_\_
- 6. \_\_\_\_\_
- 7. \_\_\_\_\_
- 8. \_\_\_\_\_
- 9. \_\_\_\_\_
- 10. \_\_\_\_\_
- 11. \_\_\_\_\_
- 12. \_\_\_\_\_
- 13. \_\_\_\_\_
- 14. \_\_\_\_\_
- 15. \_\_\_\_\_
- 16. \_\_\_\_\_

#### WIRING DIAGRAM LEGEND


- NA - 1 NA OR 2 NC BREAKER POLES
- NC - 1 NA OR 1 NC BREAKER POLE
- NC - 1 NC BREAKER POLE

USE COPPER OR ALUMINUM WIRE

FEDERAL PACIFIC ELECTRIC COMPANY  
NEWARK, NEW JERSEY

WARNING: THE CIRCUIT BREAKERS IN THIS BOX HAVE BEEN SELECTED TO PROTECT THE WIRING. TO AVOID LOSS OF LIFE OR PROPERTY DO NOT REPLACE WITH A HIGHER RATING CIRCUIT BREAKER. IF CHANGES ARE NECESSARY CALL A QUALIFIED ELECTRICIAN.

INSTALLED BY:

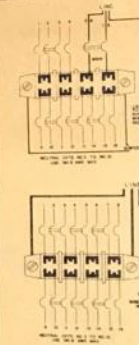

Suitable for use on having maximum available fault current not exceeding 10,000 RMS Symmetrical Amperes when all listed Circuit Breakers are 10,000 RMS Symmetrical Amperes interrupting rating National Electrical Code Section 240 Breakers must be same type and rating.